

NOTE: FOR WALL THICKNESS (T) SEE TABLE A.





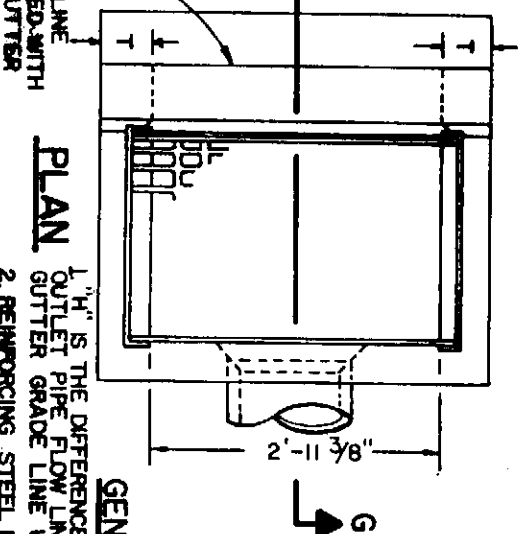


TABLE A

H	T
8'-0" OR LESS	6"
8'-1" TO 20'-0"	8"


GENERAL NOTES

1. "H" IS THE DIFFERENCE IN ELEVATION BETWEEN THE OUTLET PIPE FLOW LINE AND THE NORMAL GUTTER GRADE LINE UNDEPRESSED.
2. REINFORCING STEEL IN WALLS SHALL BE # 4 BARS AT 16" CENTERS PLACED 1/2" CLEAR TO INSIDE OF BOX UNLESS OTHERWISE SHOWN.
3. STEPS - NONE REQUIRED WHERE "H" IS 3'-6" OR LESS. INSTALL ONE STEP 16" ABOVE FLOOR WHEN "H" IS MORE THAN 3'-6" AND LESS THAN 5'-0". WHERE "H" IS MORE THAN 5'-0", STEPS SHALL BE EVENLY SPACED AT 12" INTERVALS FROM 16" ABOVE FLOOR TO WITHIN 12" OF THE TOP OF THE BOX. PLACE STEPS IN WALL WITHOUT PIPE OPENINGS.
4. PRES) CAN BE PLACED IN ANY WALL.
5. CURB SECTION SHALL MATCH ADJACENT CURB.
6. BASIN FLOORS SHALL HAVE WOOD TROWEL FINISH AND A MINIMUM SLOPE OF 12:3 FROM ALL DIRECTIONS TOWARD OUTLET PIPE.
7. ALL HARDWARE SHALL BE GALVANIZED.
8. WHEN USING STANDARD ROLLED CURB & GUTTER, WARP TO VERTICAL CURB 12.
9. WHEN APRON IS REQUIRED WITH DROP-INLET EXTEND # 4 SIDEWALL RE-BAR 12" INTO TAPERED GUTTER PAN.
10. DELETE APRON IN NON CURB & GUTTER AREAS.

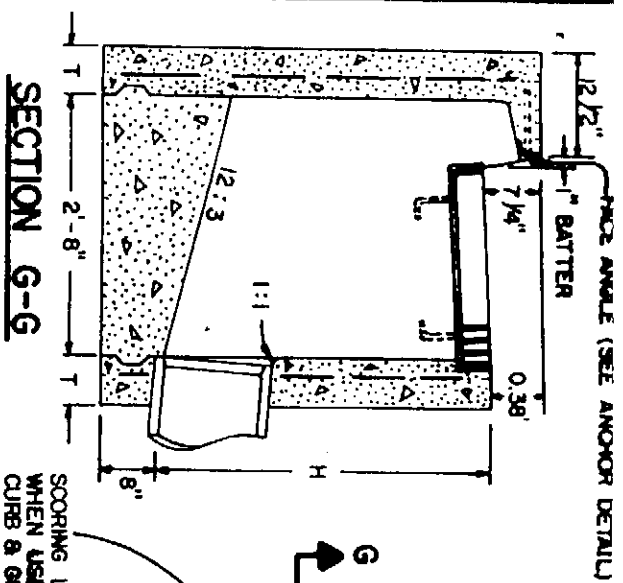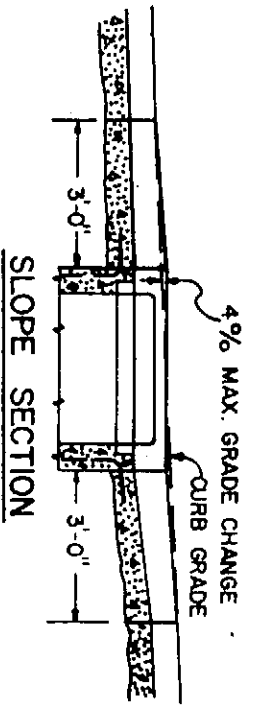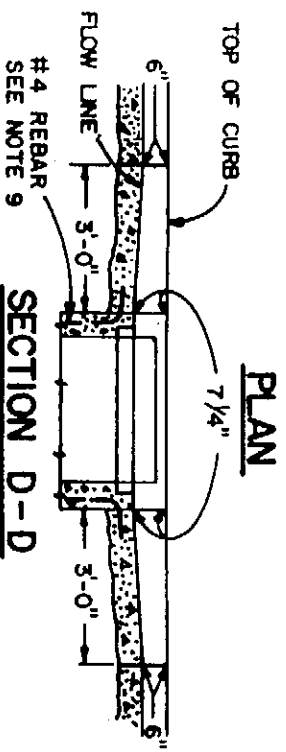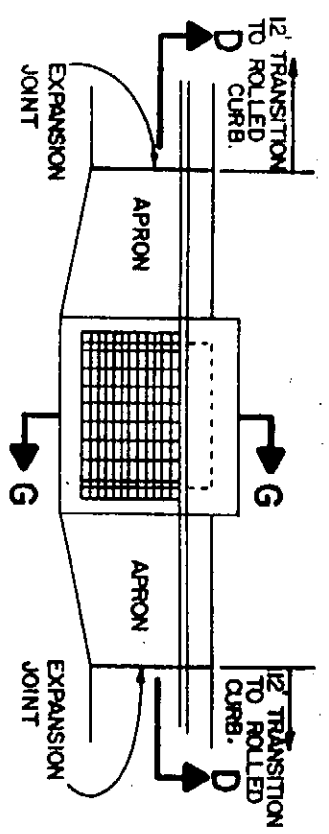


SLOPE NOTES


D.I. GRADE	ROAD GR.
MATCH	RD. GRADE
4%	0-4%
HOLD 4% GR. CHANGE	4-8%
	8%-UP

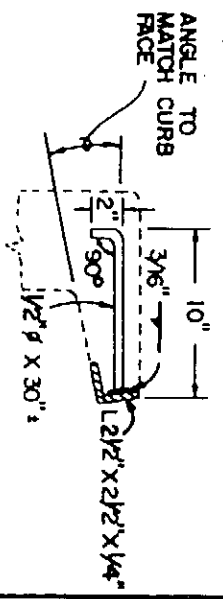

STEP DETAIL

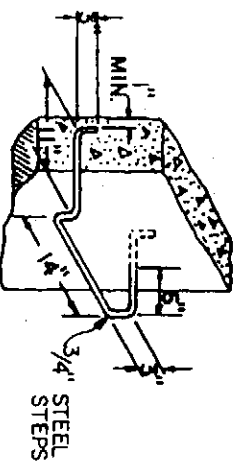

FACE ANGLE ANCHOR DETAIL



TYPE 24-13 GRATE
NOTE: FRAME & GRATING SHALL CONFORM TO PINKERTON FOUNDRY TYPE A-654 OR EQUAL.

COUNTY OF GLENN — SUBDIVISION STANDARDS

STANDARD GO TYPE DROP INLET & DETAILS (NO SCALE)

REV. DATE	DWG. NO.

S-6